



# Water Infrastructure Standard Details

Connections and Developer Services  
Construction Requirements for Self-Lay Developments  
July 2020 (Revision 4)  
Document No. CIS-5609-01



**NOTE:** CONTRACTOR IS TO REFER TO REVISION 4 OF THE IRISH WATER STANDARD DETAILS DATED JULY 2020 FOR WATER INFRASTRUCTURE DETAILS. THIS BOOKLET HAS BEEN INCLUDED AS PART OF THE CIVIL/STRUCTURAL PACKAGE.

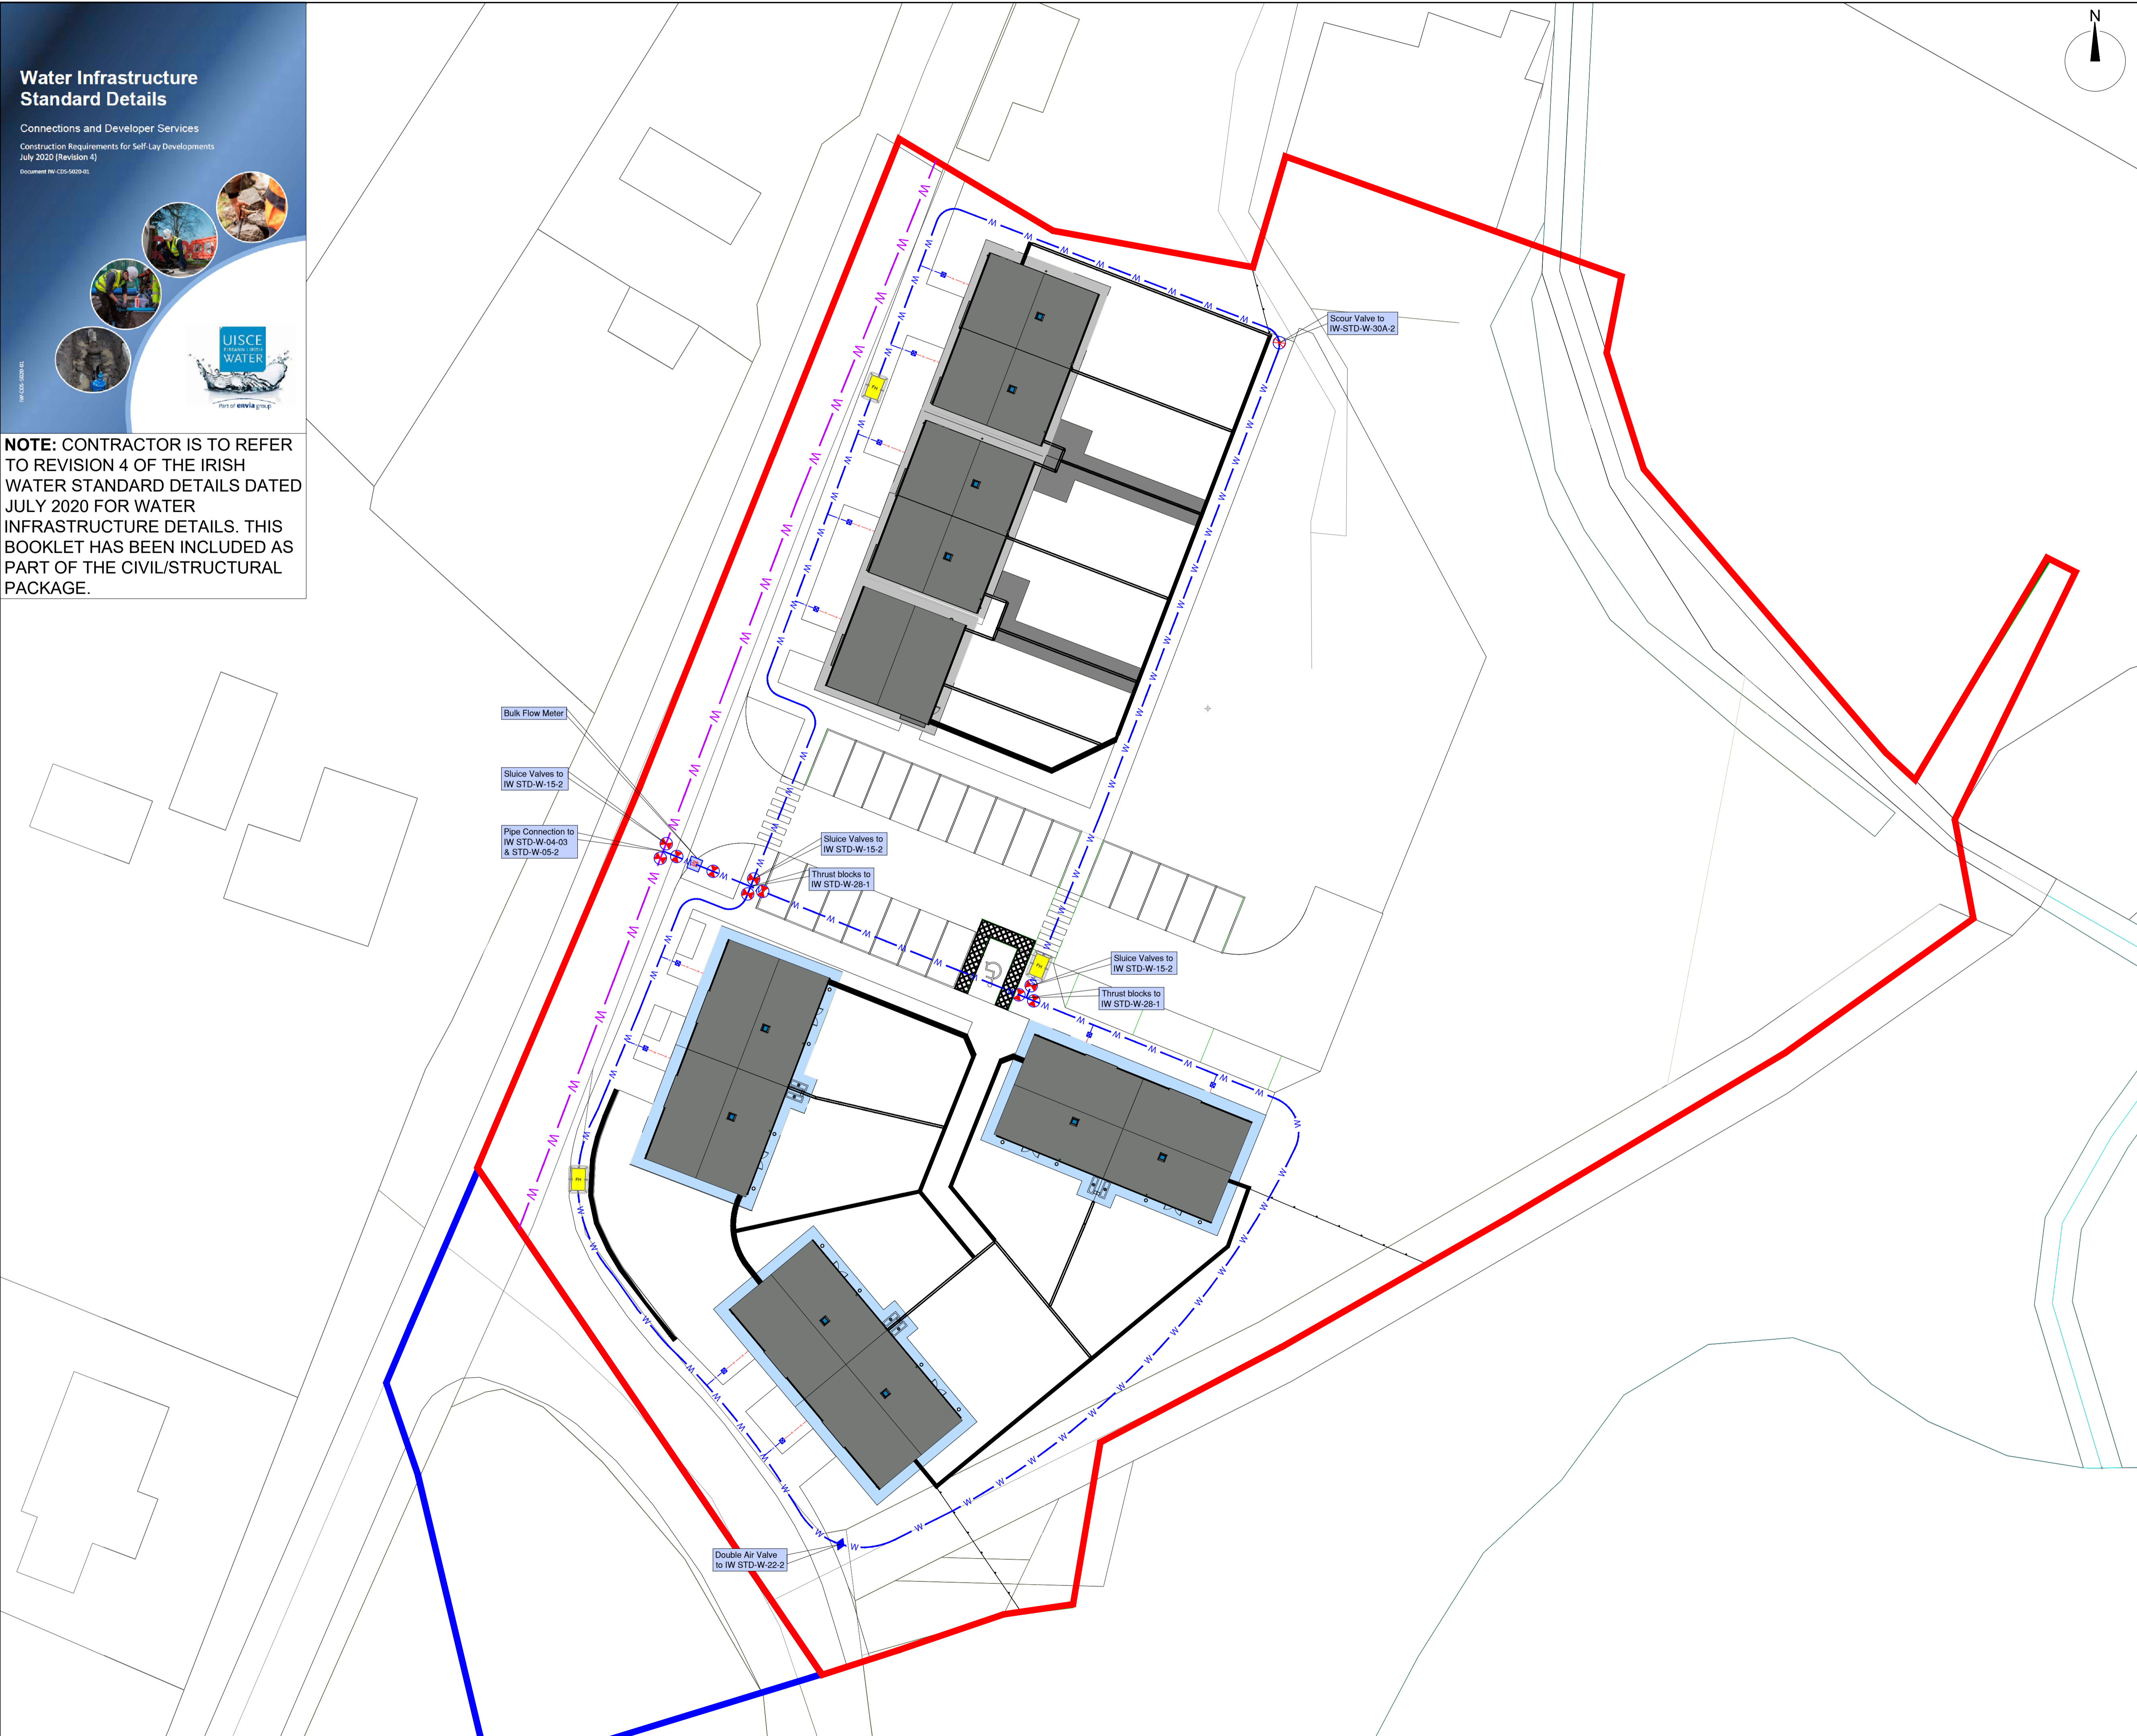

## NOTES

### GENERAL NOTES:

- FIGURED DIMENSIONS ONLY TO BE TAKEN FROM THIS DRAWING.
- ALL DRAWINGS TO BE CHECKED BY THE CONTRACTOR ON SITE.
- ENGINEER/EMPLOYERS REPRESENTATIVE, AS APPROPRIATE, TO BE INFORMED BY THE CONTRACTOR OF ANY DISCREPANCIES BEFORE ANY WORK COMMENCES.
- THE CONTRACTOR SHALL UNDERTAKE A THOROUGH CHECK FOR THE ACTUAL LOCATION OF ALL SERVICES/UTILITIES, ABOVE AND BELOW GROUND, BEFORE ANY WORK COMMENCES.
- ALL LEVELS SHOWN RELATE TO ORDNANCE SURVEY DATUM AT MALIN HEAD.
- THIS DRAWING IS TO BE READ IN CONJUNCTION WITH ALL OTHER RELEVANT DRAWINGS AND SPECIFICATIONS. CONTRACTOR TO VERIFY THE ACCURACY OF THIS PROPOSAL TO THE ENGINEER AND ALLOW FOR MINOR CORRECTIONS AS DEEMED NECESSARY WITH A REASONABLE TIMEFRAME.

### LEGEND

- SITE BOUNDARY shown thus
- WATERMAIN SUPPLY Ø 110mm OUTSIDE DIAMETER PE100 JDR1. PIPE MATERIAL SHALL BE IN COMPLIANCE WITH IRISH WATER SECTION 3.9 OF THE CODE OF PRACTICE.
- PROPOSED WATER SUPPLY CONNECTION WITH BOUNDARY BOX TO I.W. STD-W-03 shown thus
- FIRE HYDRANT TO I.W. STD-W-18/19 shown thus (3 No. Hyd)
- SLUICE VALVE TO I.W. STD-W-15-2 shown thus (10 No. SV's)
- SCOUR VALVE TO I.W. STD-W-30A-2 shown thus (1 No. SC.v's)
- BULK FLOW METER To Incl. Kiosk to STD-W-36 AND METER CHAMBER TO STD-W-26 shown thus
- EXISTING WATERMAIN

Site Area:-  
9,900 m<sup>2</sup>, 2.44 Acres, 0.99 Hectares  
ITM Co-Ordinates of site:-  
524360, 794418  
Ordnance Survey Ireland Licence No. CYAL50244098  
© Ordnance Survey Ireland/Government of Ireland.  
OS Sheet No. 1908

D.01	Issued for Discussion	AP	MF	20.05.22
rev.	modifications	by	chkd	date
Layout Ref.:				
file	P:\Jod-jobs\6786 Ballyvary Housing\700 Drawings\703 Planning\01 WIP\6786-JOD-XX-ZZ-DR-C-700-006 Watermain Site Layout Plan.dwg			

client Comhairle Contae Mhaigh Eo  
Mayo County Council

project  
PROPOSED HOUSING AT BALLYVARY,  
CO. MAYO.

stage  
DRAFT

title  
WATERMAIN SITE LAYOUT PLAN

scale  
1:250 @ A1

surveyed	drawn	checked	date
JOD	AP	MF	May 2022

© COPYRIGHT OF  
**JENNINGS O'DONOVAN & PARTNERS**  
CONSULTING ENGINEERS,  
FINISKLIN,  
SLIGO,  
IRELAND.  
TEL. +353 (0)71 916 1416  
FAX. +353 (0)71 916 1080  
Email: info@jodireland.com

drawing no.	revision
6786-JOD-XX-ZZ-DR-C-700-007	D.01